MSB Design

BS6305 Test A.3 Determination of shunt capacitance

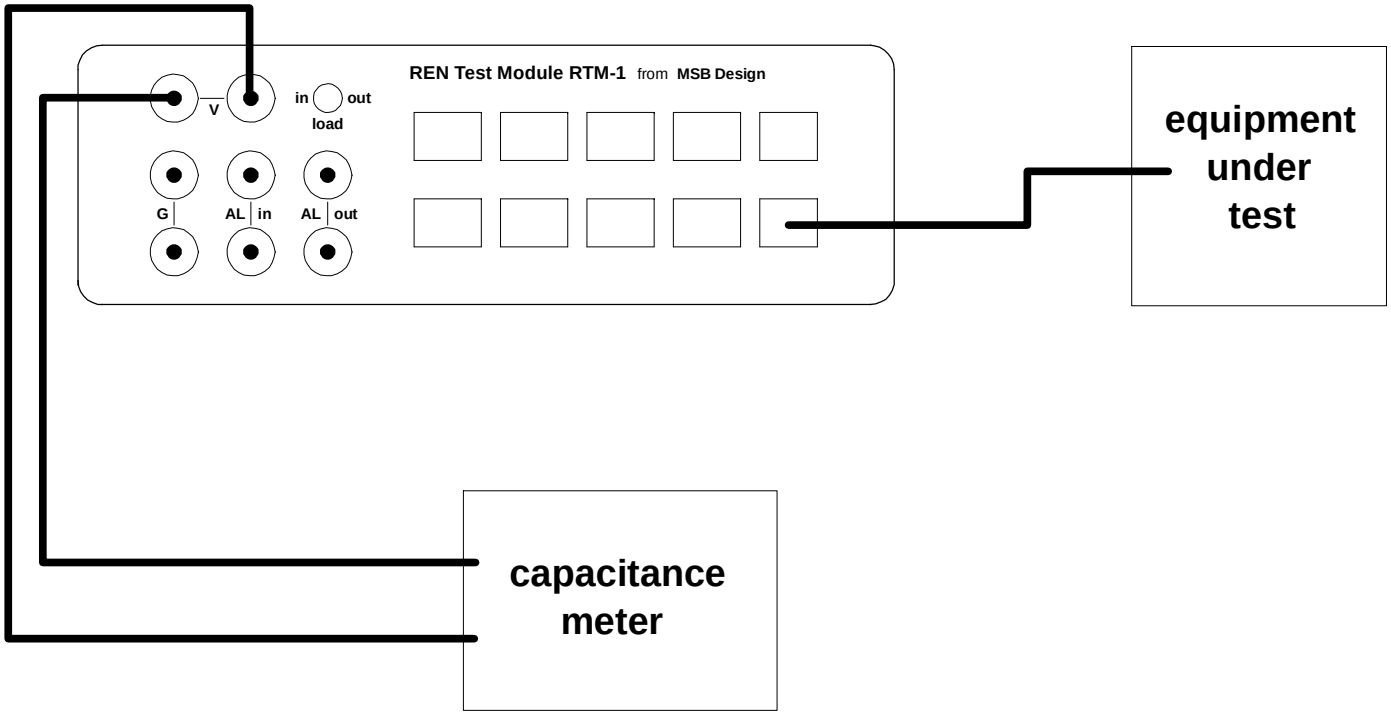

Settings :-
RTM-1 switch the dummy load OUT
Inital measurements are done with the equipment under test disconnected

The capacitance of the circuit is measured with the equipment under test (EUT) disconnected from the REN Test Module RTM-1. Then the EUT is plugged in and the capacitance measured once more. The shunt capacitance is the difference of the two measurements.